




Cush Wind Farm
Phase II


Environmental Impact
Assessment Report

Annex 3.6: Electrical Switch Room Building Compound Plan

Cush Wind Limited

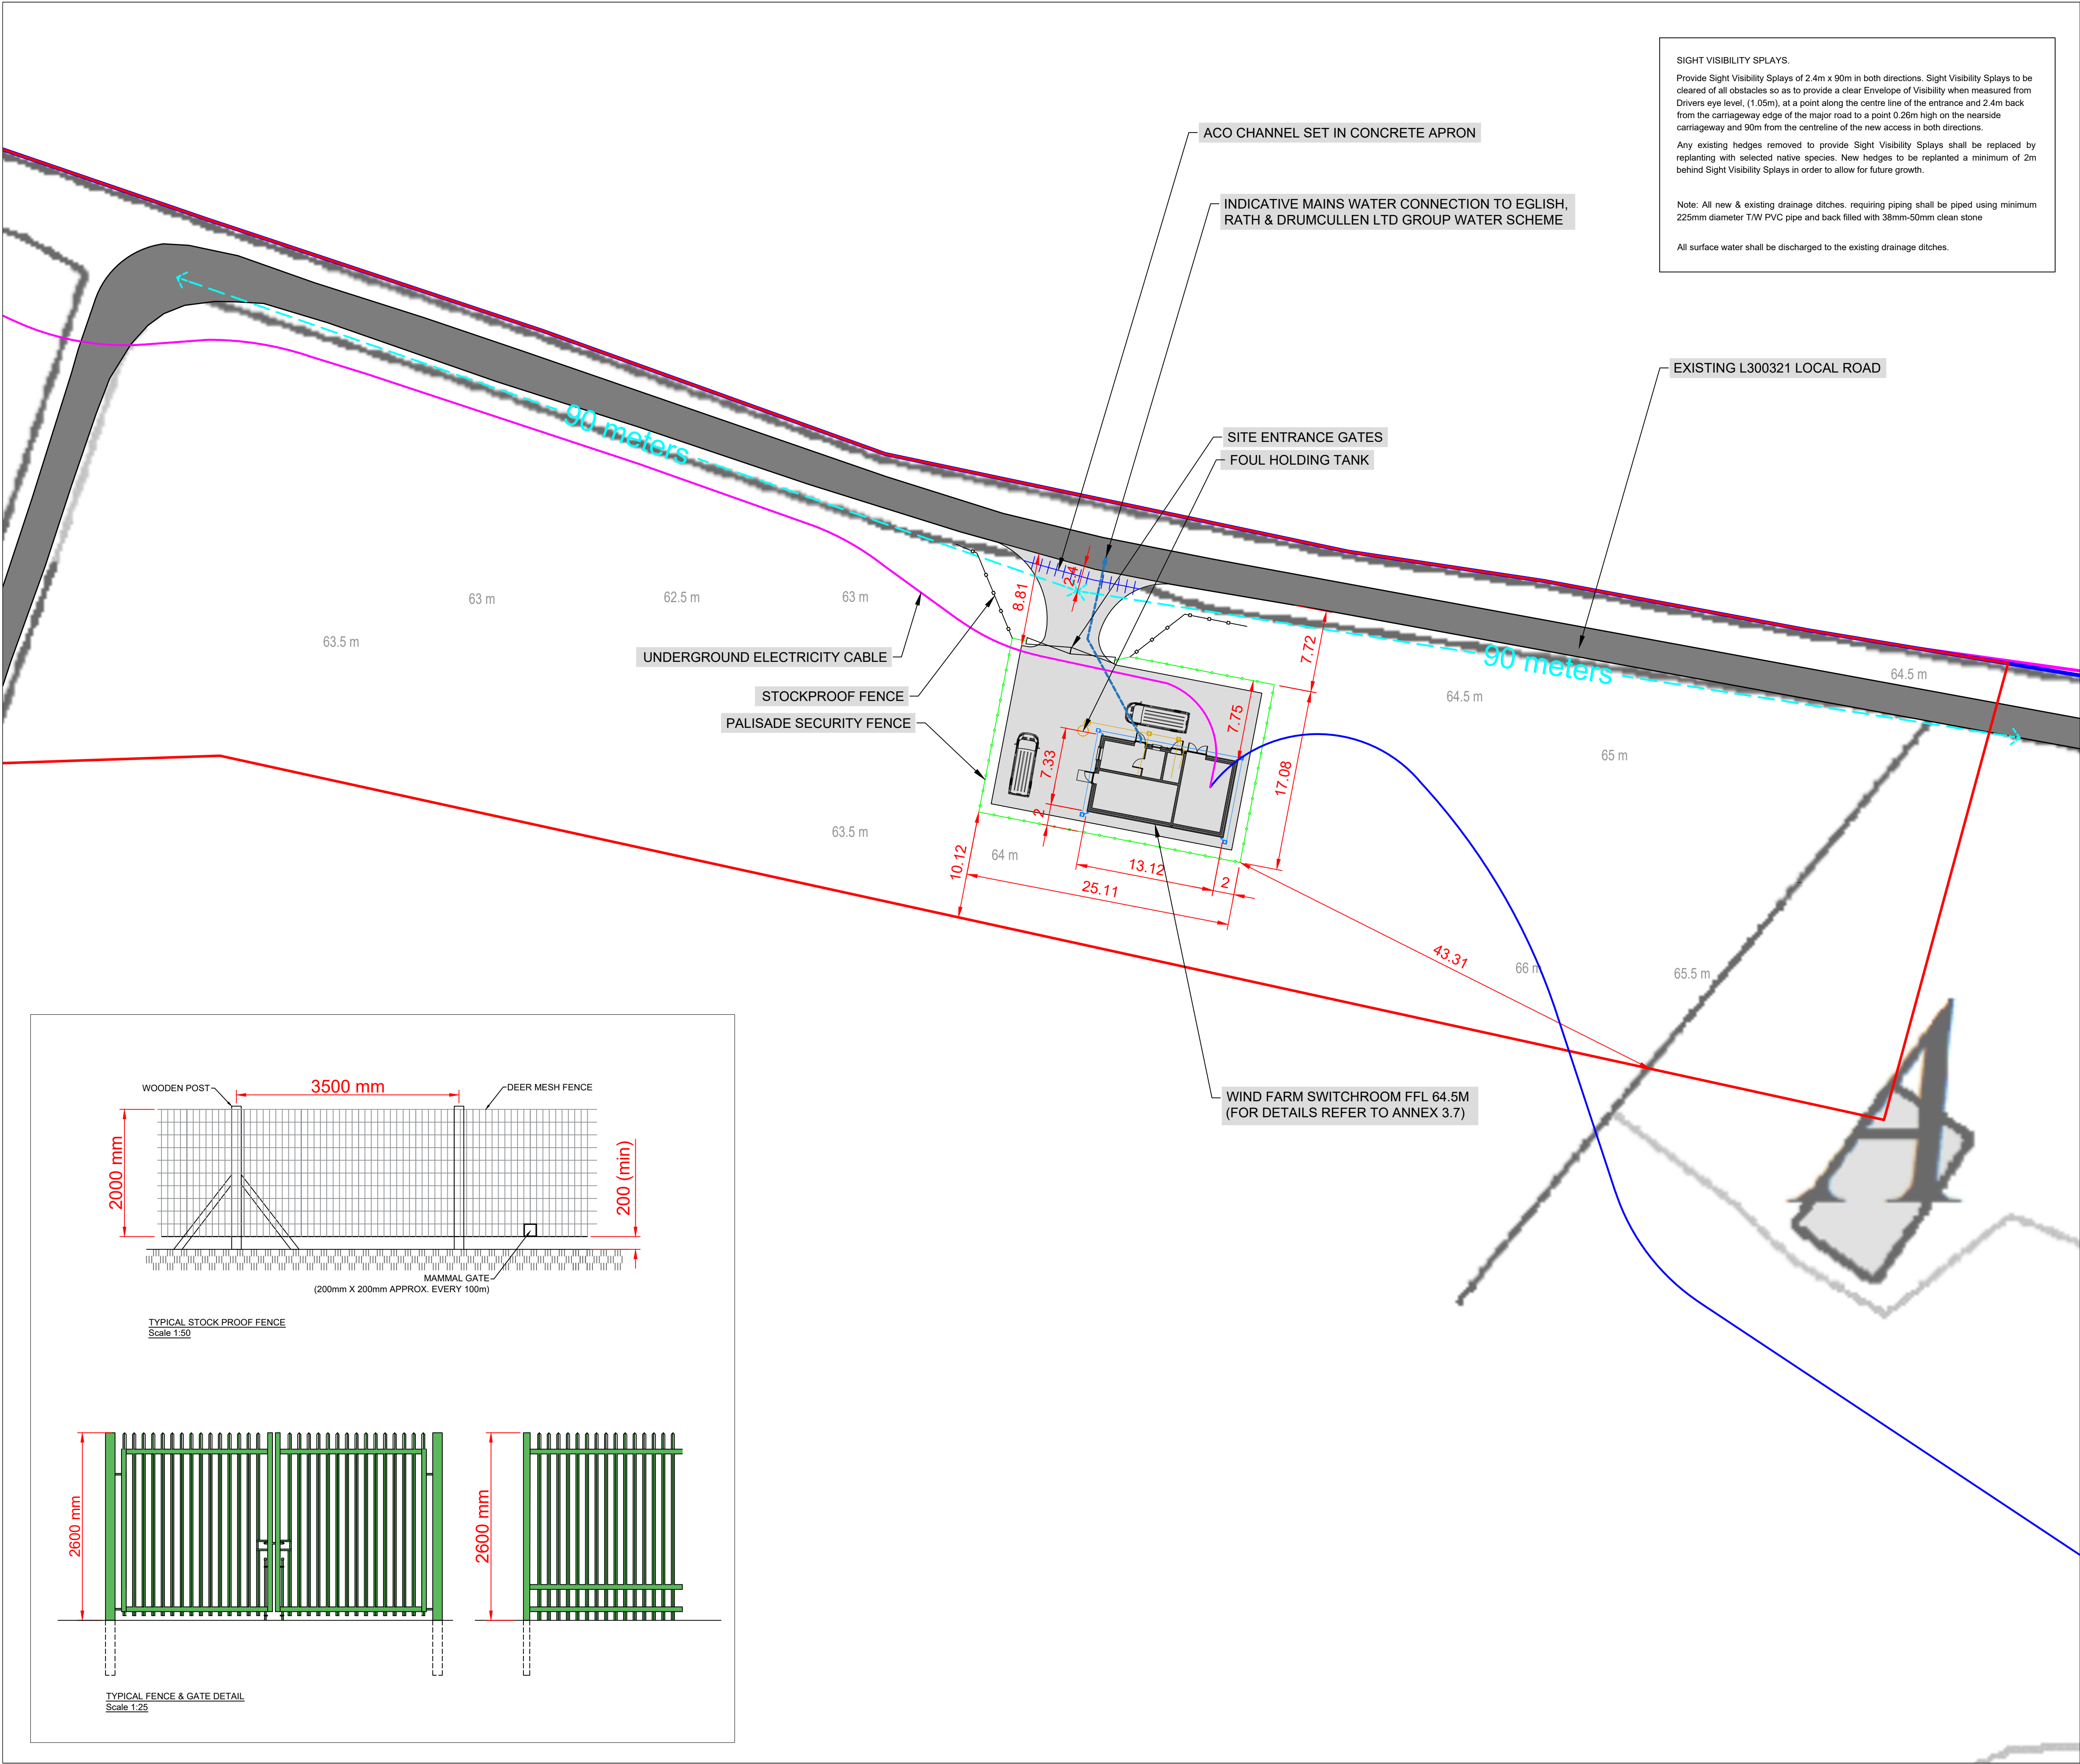

- Legend:**
- Internal Wind Farm Electrical and Communications Cabling
 - Underground Electricity Line
 - Wind Farm Switchroom Layout
 - Access Track & Hardstanding
 - Existing Public Road
 - Palisade Fence
 - Stock Proof Fence
 - Indicative Water Connection
 - Site Entrance Visibility Splay

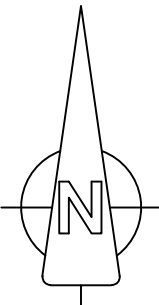

OSI © Licence: CYAL50510175, OS Map Ref. No. 3643, 3644, 3701, 3702. Prepared Using Irish Transverse Mercator (ITM).			
Date:	Rev:	Description:	Drawn By:
Prepared By:			
 <div>Galetech Energy Services Clondorgan, Stradone Co. Cavan, H12 NV06 info@galetechenergyservices.com www.galetechenergyservices.com</div>			
Client: CUSH WIND LIMITED			
Job Title: CUSH WIND FARM PHASE II			
Drawing Title: Annex 3.6 - Electricity Switchroom Compound Site Layout			
Drawing No.: CUSH001_EIAR_3.6		Stage: EIAR	
Scale: (A1) 1:300	Date: 23/10/2026	Revision No.: REV 02	
Drawn By: EF	Checked By: DO	Confirmed By: DO	